

Cavity trays to bay windows

(April 2024) (Second issue – supersedes December 2008)

The Technical Guidance Notes are produced by NHBC as guidance solely for our builder customers as to how to interpret the technical requirements in relation to the warranty cover provided by NHBC under its Buildmark, Buildmark Choice, Buildmark Link, Buildmark Solo, Buildmark Connect or any similar product from time to time. It has not been created or intended for distribution or use outside of that purpose. The information contained in this Technical Guidance Note does not constitute advice and is not to be relied upon by any third party. Nothing in this Technical Guidance Note is intended to, nor should it be taken to, create any legal or contractual relationship. Any third party who chooses to rely upon the information contained in the Technical Guidance Notes shall do so entirely at their own risk and NHBC accepts no duty of care or liability, however caused, in connection with its use or reliance by any third party.

Question

Where a bay window has sloping roof abutments with stepped lead flashings is a single full width horizontal cavity tray at the upper flashing level sufficient protection or are stepped cavity trays down each roof slope also needed?

Considerations

- NHBC Standards clause 6.1.17 states that where the roof abuts at an angle with the cavity wall, preformed stepped cavity trays should be provided.
- Cavity trays to the roof should link with and extend beyond the vertical DPCs at the window reveals to provide a continuous barrier to water penetration into the room below.
- A single horizontal cavity tray placed at the upper flashing level will not link with the vertical DPCs and will leave open cavities down each roof slope through which water could penetrate into the room below.


Answer

Horizontal cavity trays with stop ends should be used above any horizontal bay roof abutments. The trays should link with vertical DPCs to the window reveals or any stepped trays below. Where the wall is fairfaced masonry weep holes should also be provided at maximum 450mm intervals.

Preformed stepped trays should be provided to each sloping roof abutment with the lowest tray extending beyond and linking with the vertical DPCs to the window reveals. The lowest stepped cavity tray should be fitted with two stop ends and a weephole in all cases.

Cavity trays to bay windows

(April 2024) (Second issue – supersedes December 2008)

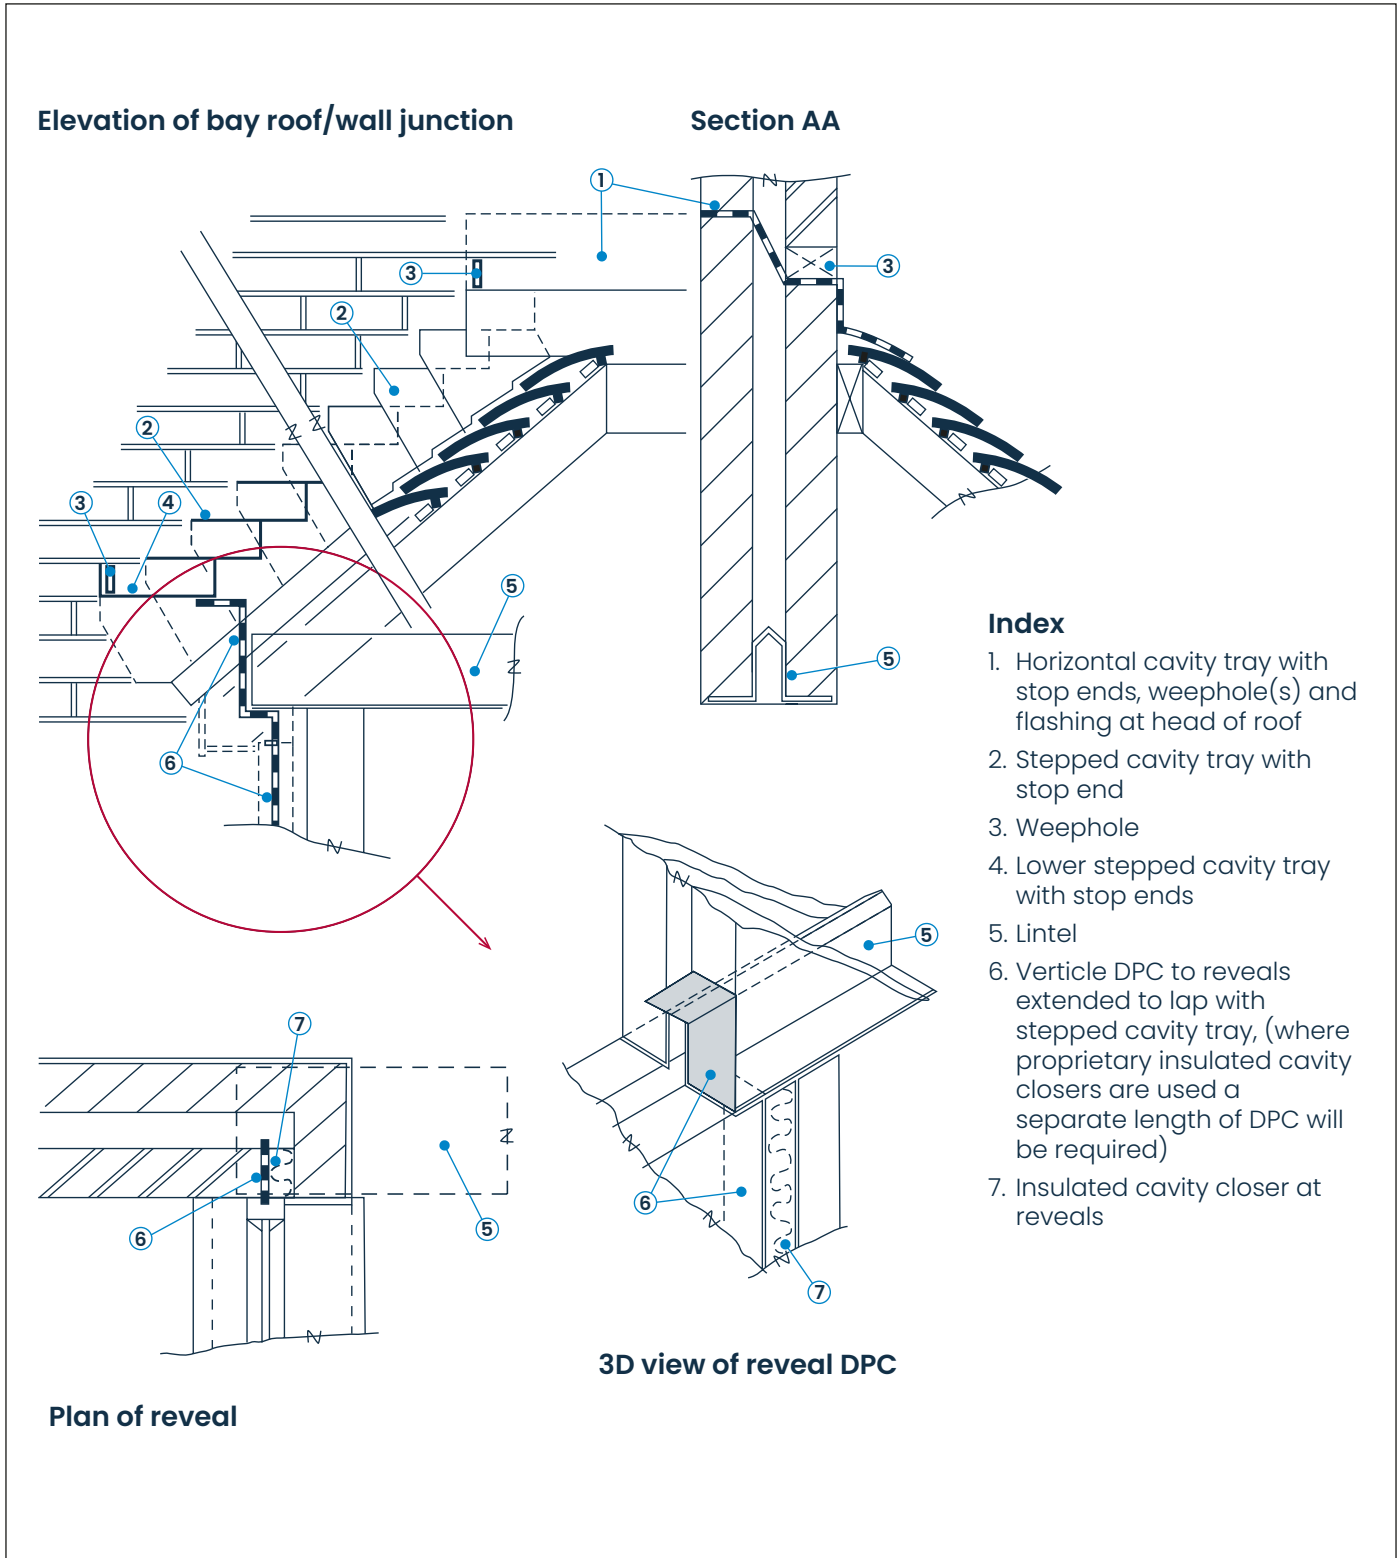

NHBC, NHBC House, Davy Avenue, Knowlhill, Milton Keynes, Bucks MK5 8FP
 Tel: 0344 633 1000 Web: nhbc.co.uk

National House-Building Council (NHBC) is authorised by the Prudential Regulation Authority and regulated by the Financial Conduct Authority and the Prudential Regulation Authority for carrying on insurance business and insurance distribution activities.

NHBC is registered in England and Wales under company number 00320784. NHBC's registered address is NHBC House, Davy Avenue, Knowlhill, Milton Keynes, Buckinghamshire, MK5 8FP. Note that only certain parts of our products and services are within the scope of UK financial services regulations. For more information on our products and services, please see our website nhbc.co.uk or your NHBC product documentation.