

Slate hook fixings

(Withdrawn – January 2024)

The Technical Guidance Notes are produced by NHBC as guidance solely for our builder customers as to how to interpret the technical requirements in relation to the warranty cover provided by NHBC under its Buildmark, Buildmark Choice, Buildmark Link, Buildmark Solo, Buildmark Connect or any similar product from time to time. It has not been created or intended for distribution or use outside of that purpose. The information contained in this Technical Guidance Note does not constitute advice and is not to be relied upon by any third party. Nothing in this Technical Guidance Note is intended to, nor should it be taken to, create any legal or contractual relationship. Any third party who chooses to rely upon the information contained in the Technical Guidance Notes shall do so entirely at their own risk and NHBC accepts no duty of care or liability, however caused, in connection with its use or reliance by any third party.

Question

Is it acceptable to use slate hooks for fixing natural slates?

Considerations

- Roof fixings should be sufficient to resist the wind uplift forces and avoid slates blowing off or chattering on the roof. Fixings should also resist lateral dislodgement of the slates.
- Slate hook fixings come in two styles i.e with a spike end for driving into the battens or a hook-over end for hooking over a tiling batten. Both types are described in BS 5534 'Code of practice for slating and tiling'.
- Slates are fixed with only one hook placed centrally along the lower edge of the slate. NHBC Standards clause 7.2.19 says slates should be fully nailed over the whole roof.

Answer

The use of hook-over type slate hooks is not acceptable. Spike-ended slate hooks may be acceptable providing they are minimum 2.7mm diameter wire and can be shown to resist the wind uplift for the roof in question. The supplier should provide wind uplift figures for the roof and his fixings to show compliance, alternatively local examples of satisfactory use of the hook fixings could be considered.

Slate hooks may be unsuitable for large slates which experience a greater wind uplift than smaller slates and for pitches above 75 degrees or below 25 degrees. Slate hooks are available with straight or crimped shanks. Crimped hooks reduce capillary action and should be used for roof pitches below 30 degrees.

Slates at the perimeter of a roof e.g. eaves, valleys, verges, ridges, hips, abutments and penetrations should be nailed to resist uplift and lateral drift.

Slate hooks should be made of stainless steel wire of the following grades:


AISI 316-S11 or S19 to BS 1554 or

1.4404 or 1.4401 to BS EN 10088-3.


Slate hook fixings

(Withdrawn - January 2024)

Top view showing straight shank and crimped shank options

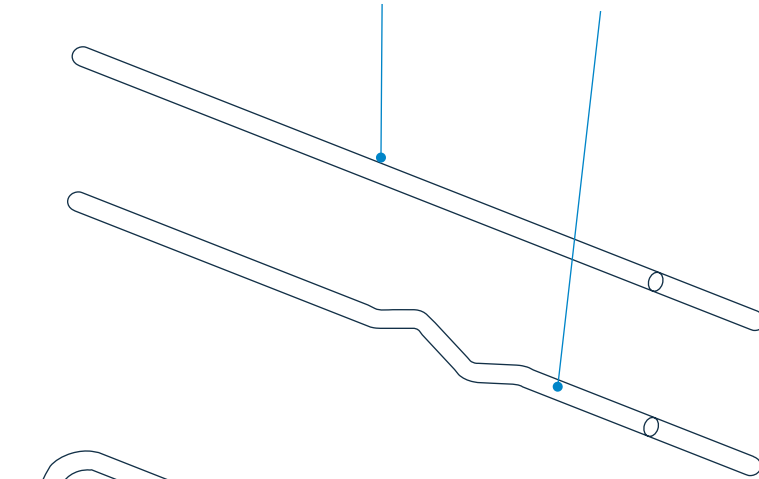

Spike ended driven slate hooks

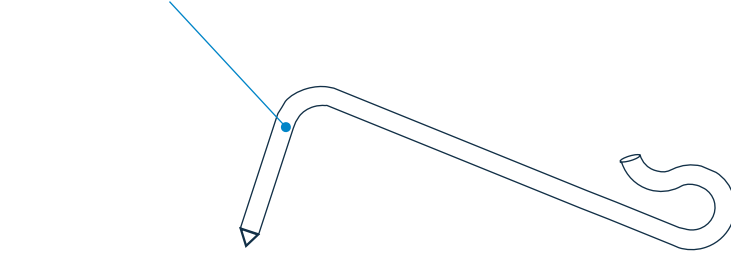

Hook over slate hook (not accepted)

